

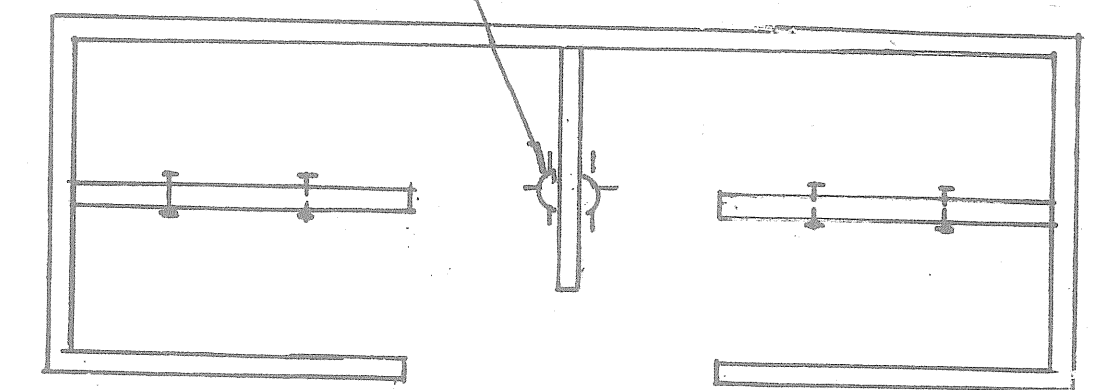

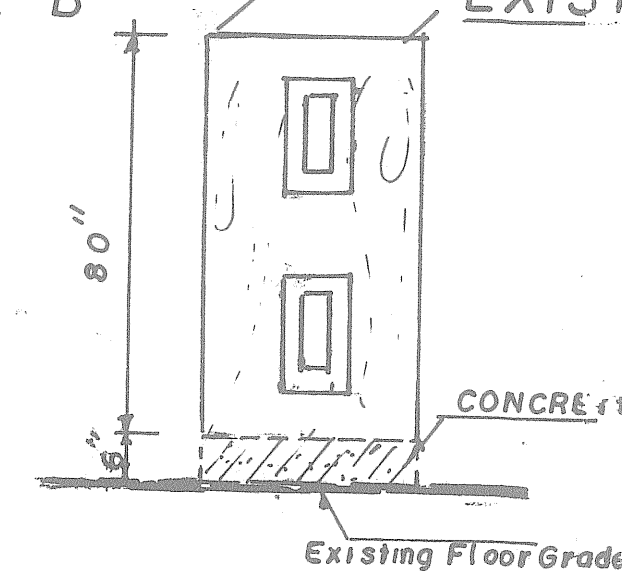
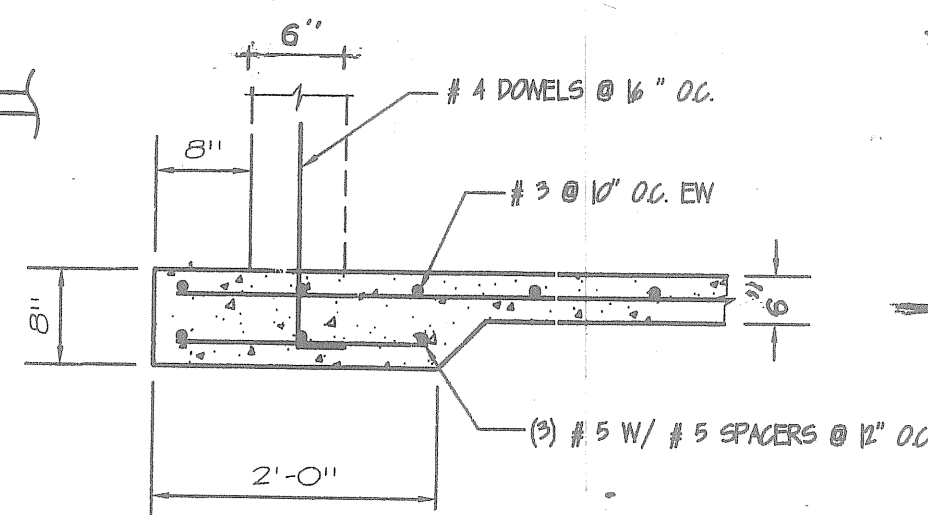
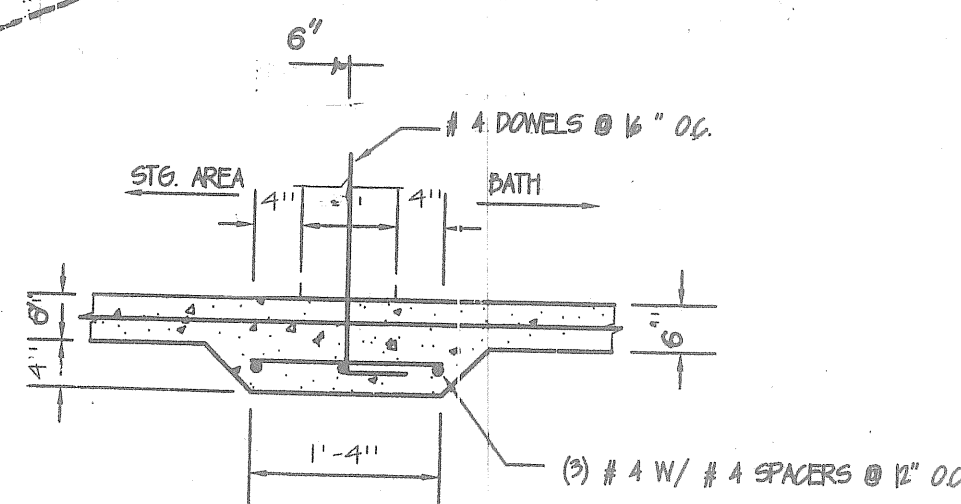
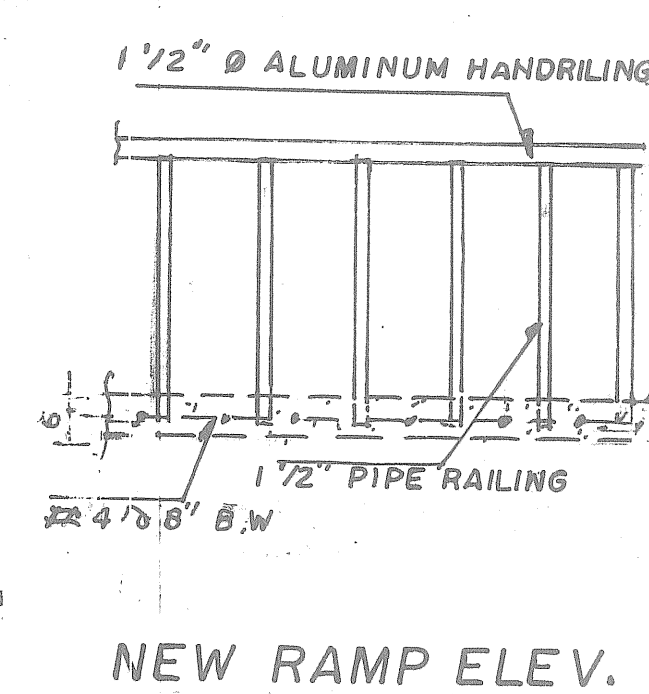
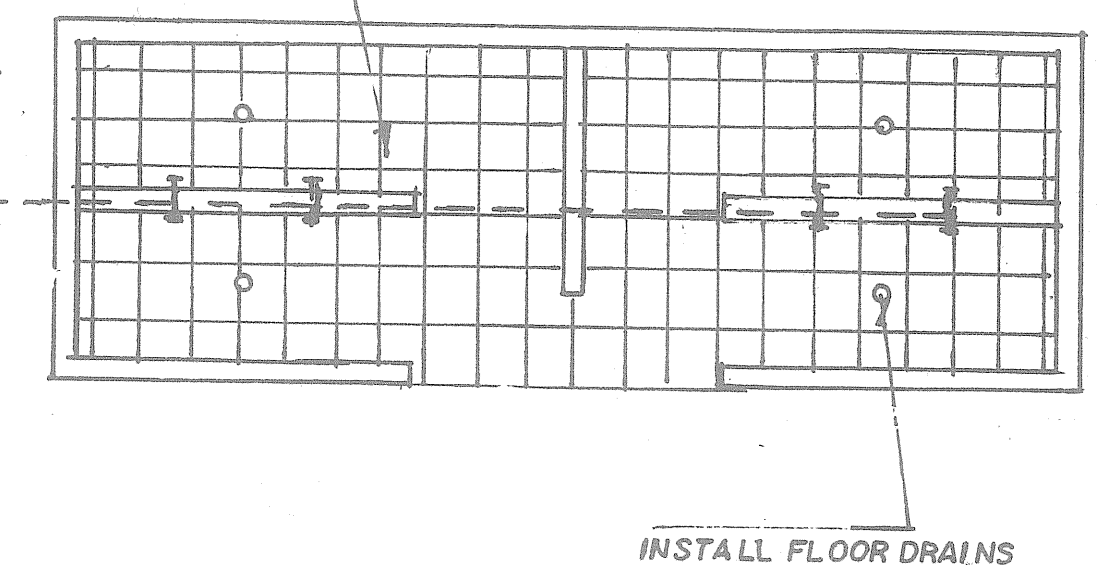
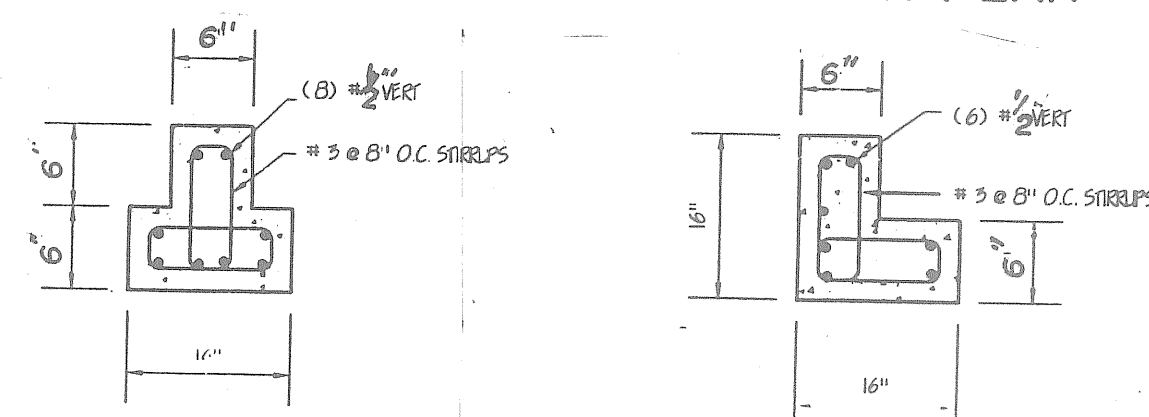


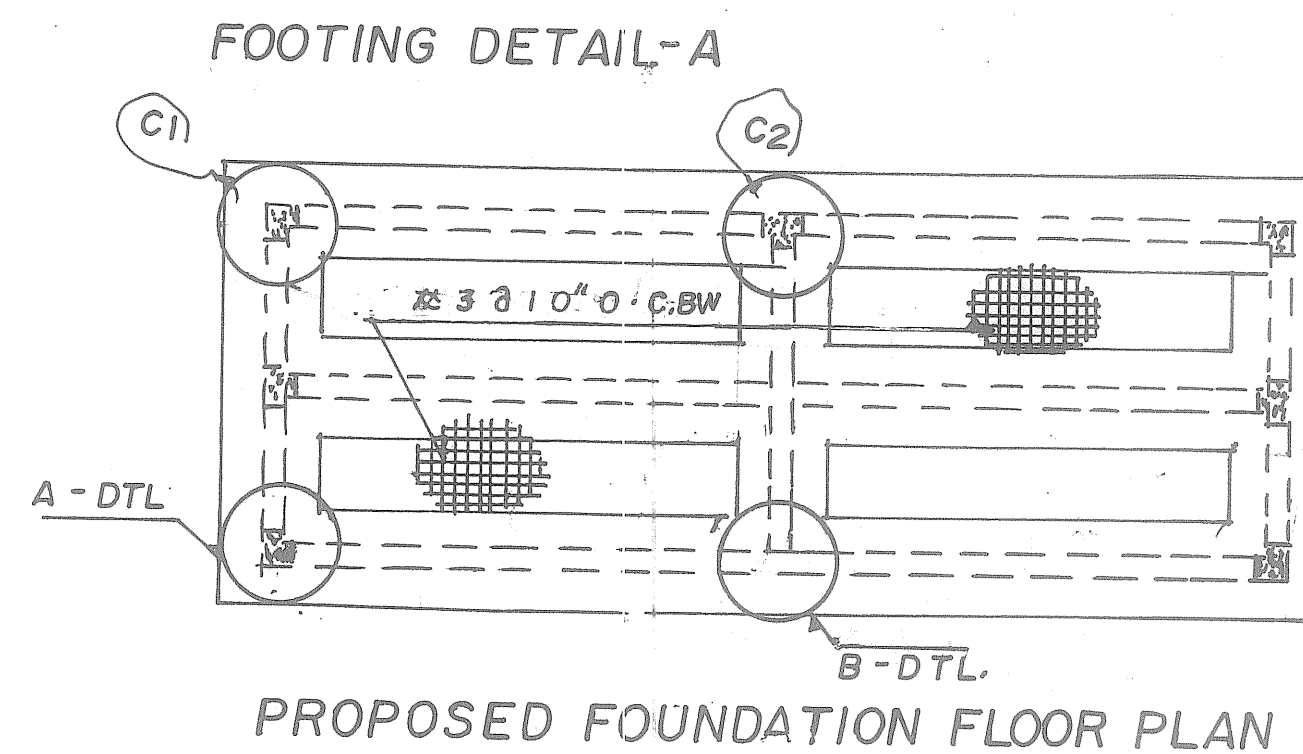

PROJECT SPECIFICATIONS

1. CONCRETE SHALL BE 3000 PSI COMPRESSIVE STRENGTH @ 28 DAYS
2. BACKFILL MATERIAL COMPACTION SHALL BE 95%.
3. THE TENSIL STRENGTH FOR REBARS SHALL BE 60,000 PSI- GRADE 60.
4. CONCRETE RAMP SURFACE SHALL BE BROOMED FINISHED
5. HANDRAILING SHALL BE BUILT W/ 1 1/2" Ø **ALUMINUM - RAILING.**

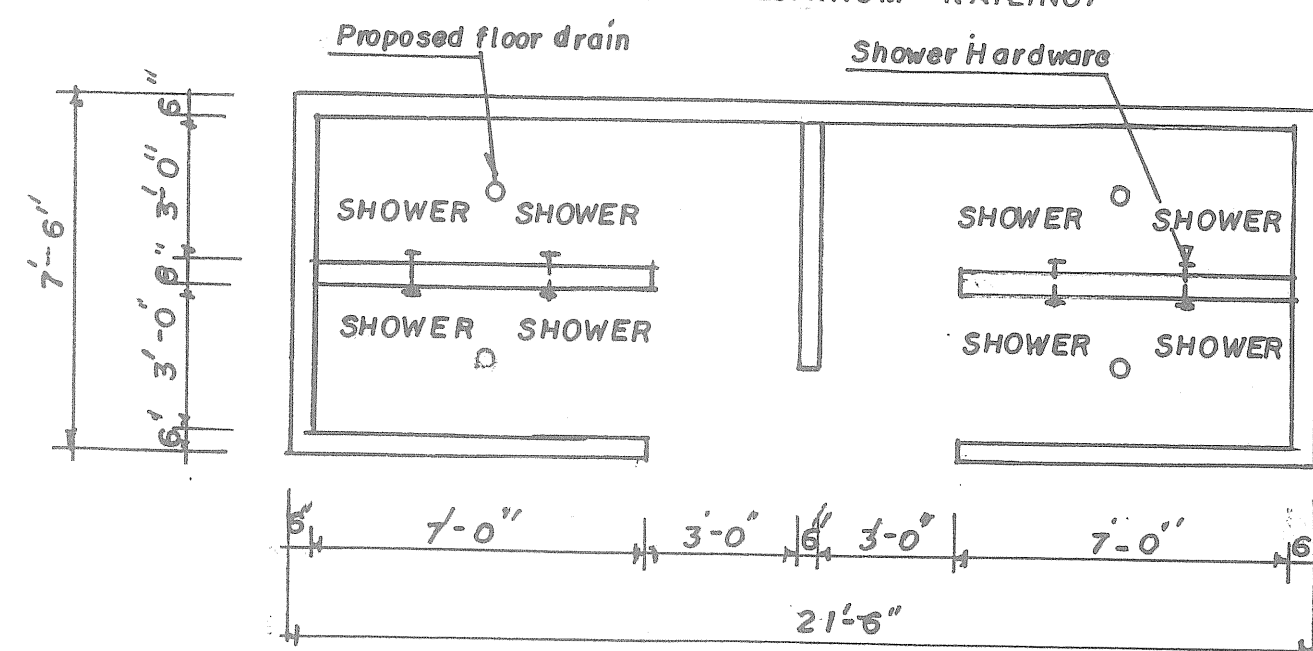

DIMENSIONAL FLOOR PLAN SC: 1/4"-1'-0"

CI - COLUMNS

C2 - COLUMNS

GOVERNMENT OF THE U.S. V. I.
DEPARTMENT OF PUBLIC WORKS

SCALE: As shown	APPROVED BY	DRAWN BY
DATE: 1-27-16		L. BROWN

PUBLIC FACILITY AT OPPENHEIMER
PROPERTY DENNIS RAY, ST. JOHN

GUSTAV - JAMES
Commissioner D.P.W

DRAWING NUMBER 14